

Figure 1

1 2



## Figure 2

FOOT 4020400E

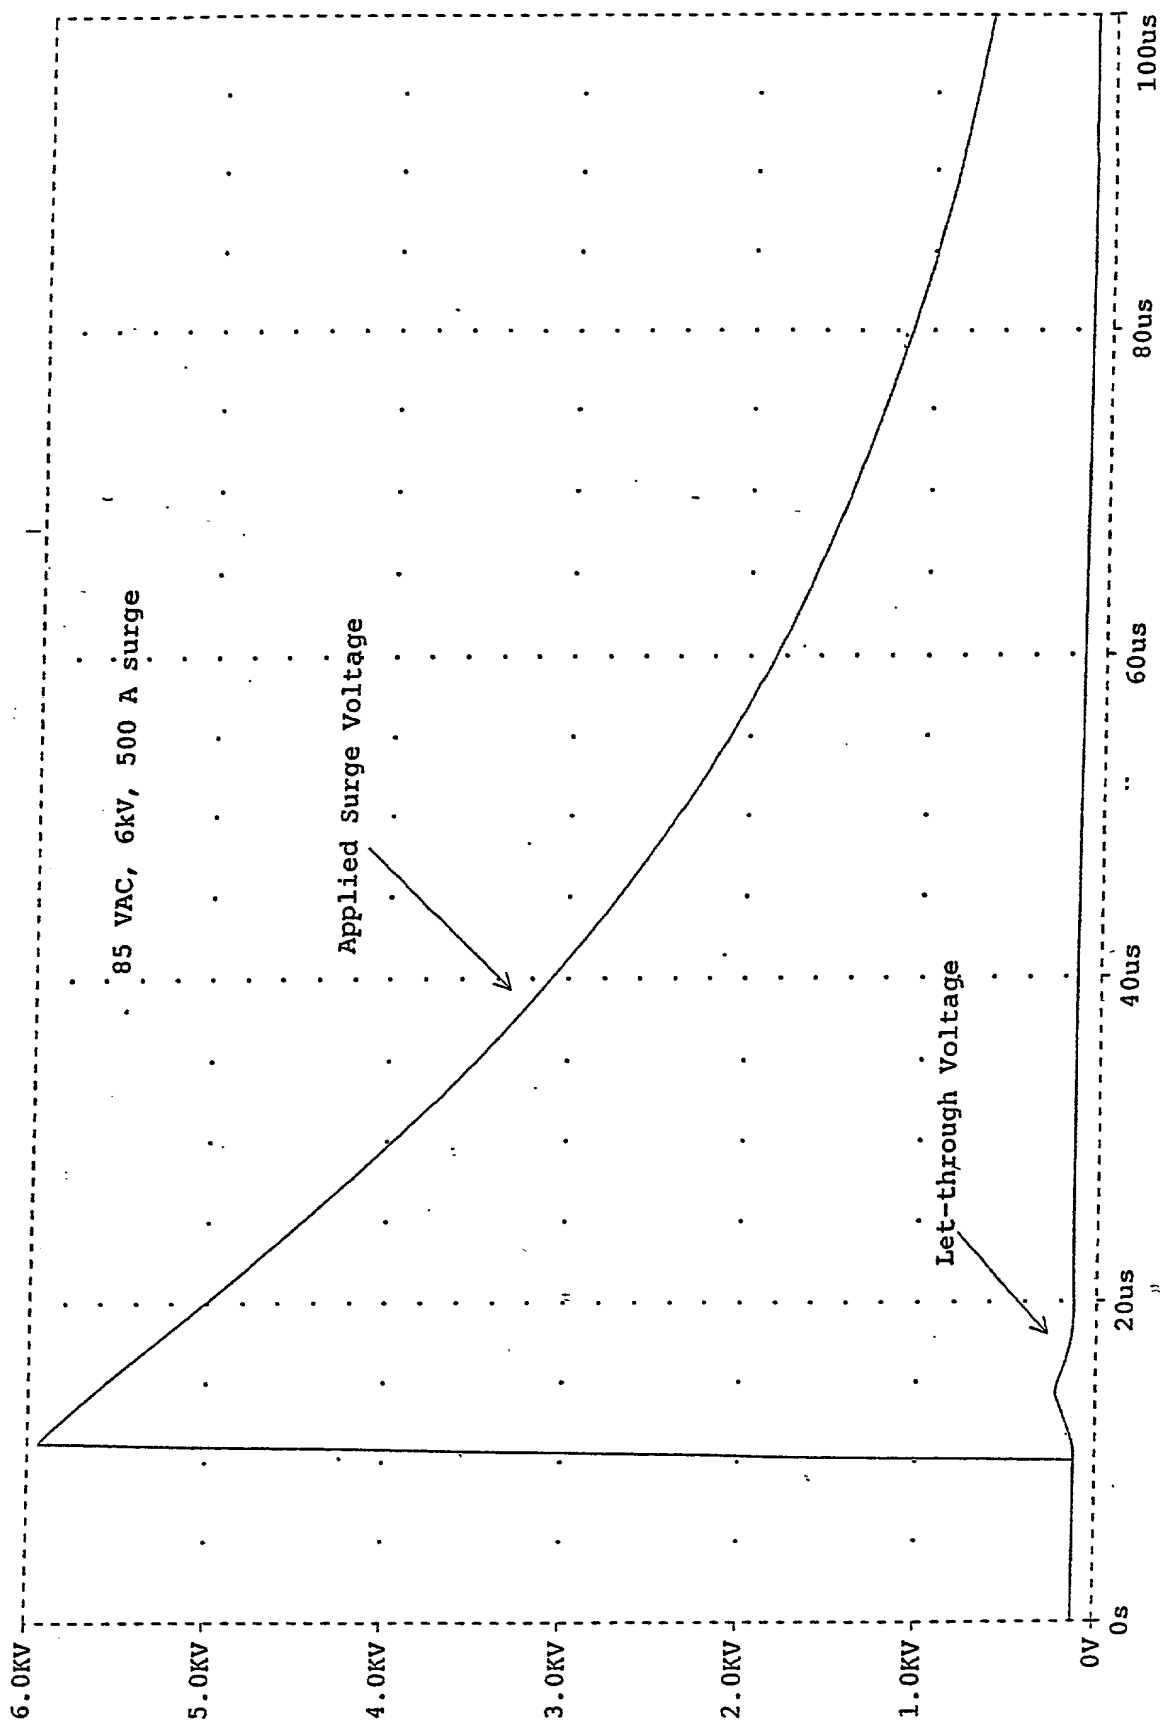


Figure 3

120 VAC, 6 kV, 500 A surge

Applied Surge Voltage

Let-through Voltage

0V 1.0KV 2.0KV 3.0KV 4.0KV 5.0KV 6.0KV

0s 20us 40us 60us 80us 100us

Time

Figure 4

### Figure 4

FOOTPRINT

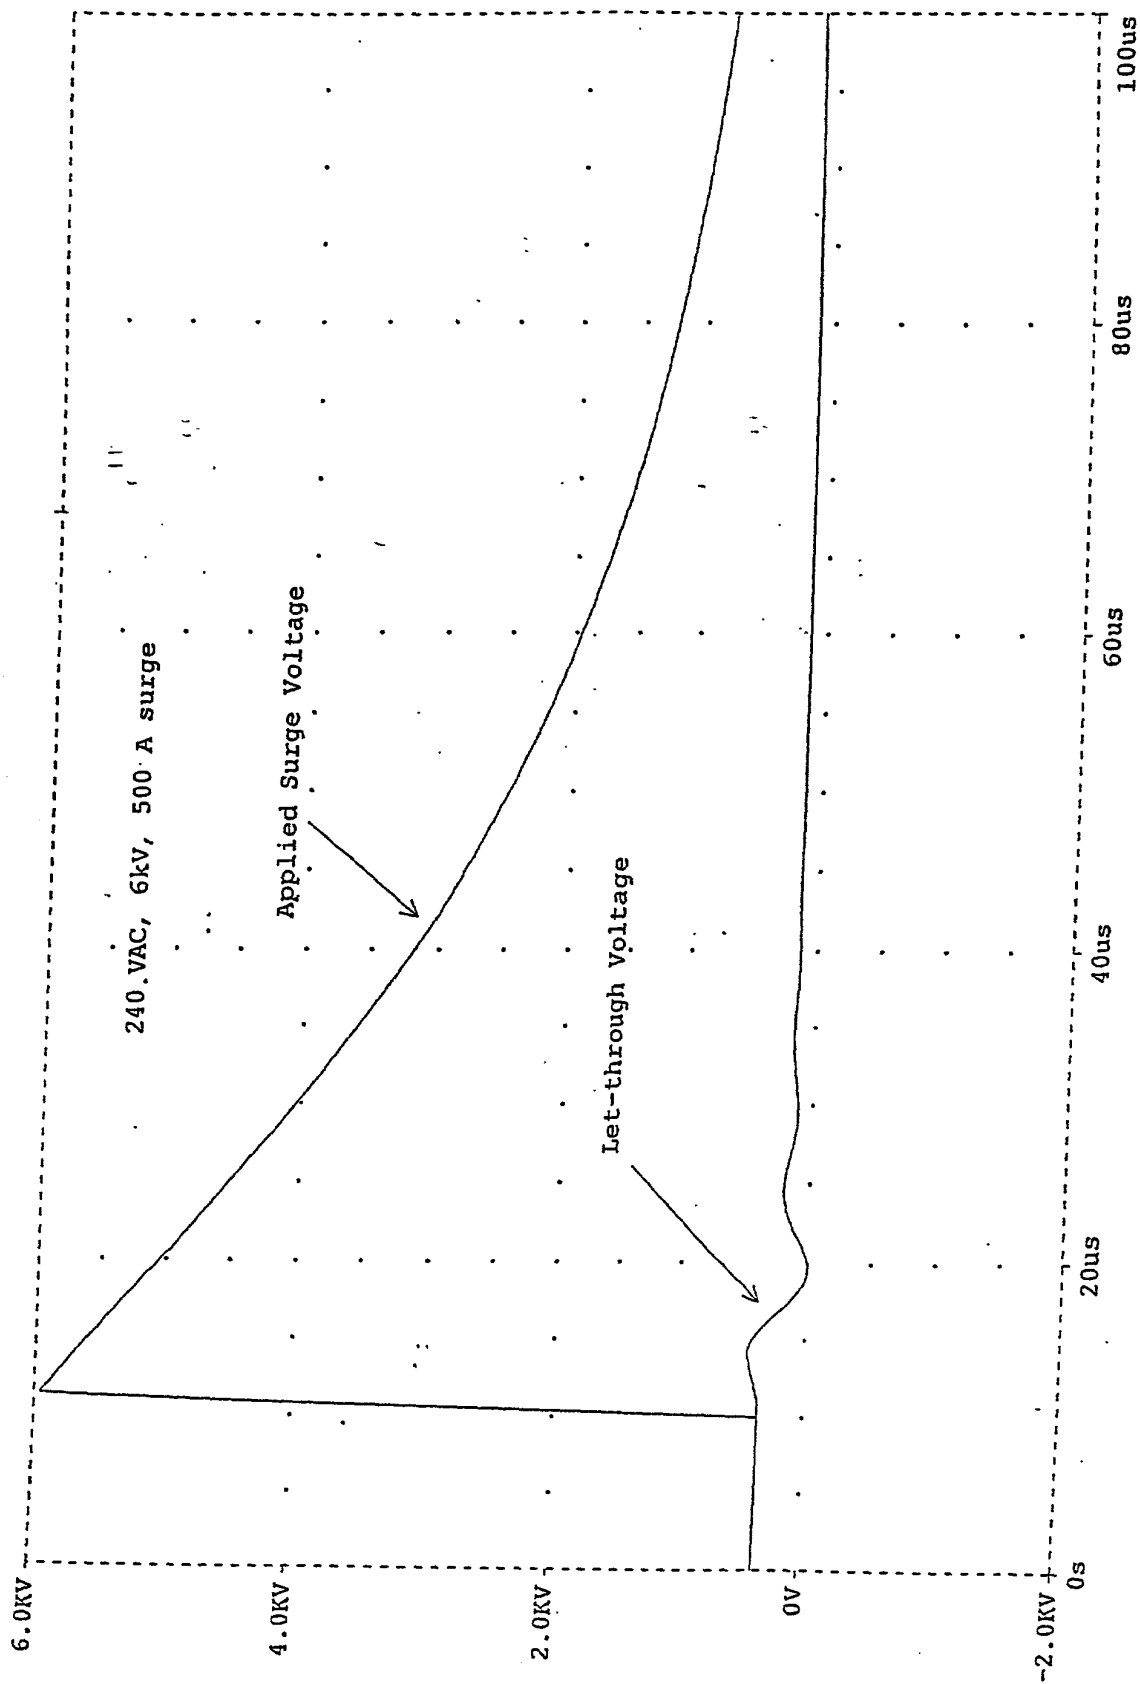


Figure 5